



ISFIELD PARISH COUNCIL

Clerk & RFO: Anita Emery CiLCA
clerk@isfieldparishcouncil.gov.uk

9th June 2026

Doc No: 2627012

TO MEMBERS OF THE COUNCIL

Dear Members, I hereby give you notice that Meeting of Isfield Parish Council will be held on **Wednesday 22nd July 2026 at Isfield Village Hall, TN22 5XG at 19:30**. All Members of the Council are hereby summoned to attend for the purpose of considering and resolving upon the business about to be transacted at the meeting as set out hereunder.

Yours sincerely

Anita Emery, Parish Clerk and RFO

Press & Public are invited to attend. Meetings are open to the public and could be filmed or recorded by broadcasters, the media or members of the public.

AGENDA

1. Apologies for absence

To **RECEIVE** any apologies.

2. Declarations of interest/Request for dispensations

To **RECEIVE** any declarations of interest. To **RESOLVE** to grant dispensations where appropriate.

3. Public Participation

Members of the public are welcome to attend the meeting. Any member of the public, who so wishes, may speak at this point of the meeting on items within the remit of the Council. No previous notice need be given. The Council are happy to receive comments but responses will be made outside meetings should they be necessary. Time limit to speak with the discretion of the Chair.

4. District and County Councillors' reports

5. Full Council meeting minutes: 20th May 2026

To **RESOLVE** that the minutes of the meeting as above having been previously circulated, be taken as read and approved.

6. Matters arising from previous minutes

7. Clerks Report

8. Correspondence

To note/discuss correspondence received.

9. Planning Applications to discuss and also any further applications that arise after publication of the agenda.

- **To RATIFY the following applications**

WD/2026/1029/F

2 LIME TREE VILLAS, STATION ROAD, ISFIELD, TN22 5XD SINGLE STOREY SIDE EXTENSION.

NO OBJECTION

- **To note the following WDC decisions**

WD/2026/0610/F

DEMOLISH THE EXISTING FREE-STANDING GARAGE/WORKSHOP AND BUILD AN ANNEXE WITH A WORKSHOP AND USABLE ROOF SPACE. 1 IVY COTTAGES, STATION ROAD, ISFIELD, TN22 5XA

APPROVED

WD/2026/1029/F

2 LIME TREE VILLAS, STATION ROAD, ISFIELD, TN22 5XD SINGLE STOREY SIDE EXTENSION.

APPROVED

10. Expenditure

- To ratify June expenditure as itemised on the schedule
- To approve July expenditure as itemised on the schedule

11. Bank reconciliation

To **RESOLVE** to approve the bank reconciliation and corresponding bank statements for IPC.

12. Year to Date Accounts

To **NOTE** the actual v budget expenditure to date

13. Pavilion

- a) To **RECEIVE** update and **DISCUSS** letter received from Cricket Club
- b) To **RATIFY** quotation for balustrade repair/replacement of £2700.00
- c) To **RECEIVE** and **NOTE** Legionnaires risk assessment
- d) To **RECEIVE** Fire Risk Assessment and **ACTION** where necessary
- e) To **RECEIVE** and **NOTE** PAT test report

14. Playing Field

To **RECEIVE** feedback on the outdoor gym proposal

15. Update: Recreation Land Registration

To receive the above from the Clerk

16. Update: EV Charge Points


To **RECEIVE** as above from Cllr Cramond.

17. Reports from Council representatives

To **NOTE** verbal reports from Councillors – e.g. Recreation Ground, Village Hall.

18. Items for reporting and/or for the next agenda

Date of next meeting: 23rd September 2026 - Full Council – 19:30

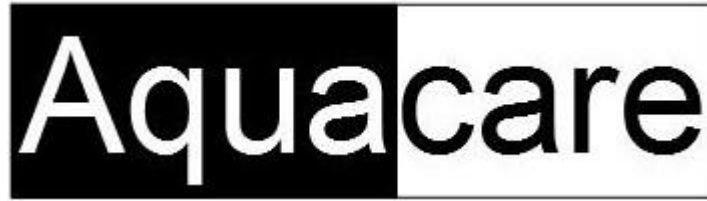

Legionella Risk Assessment At

Isfield Sports Pavilion
Station Road
Isfield
TN22 5EY



Date of survey: 8th June 2026

Surveyor: Mark Fry

Date next assessment due 8th June 2028

Audited by Paul Williams

Sussex House, 190 South Coast Road, Peacehaven, BN10 8JJ
Tel: 01273 423331 Email mail@aquacareltd.co.uk

The bacteria that causes Legionnaires Disease

Legionella bacteria are common and can be found naturally in environmental water sources such as rivers, lakes and reservoirs, usually in low numbers. Legionella bacteria can survive under a wide variety of environmental conditions and have been found in water temperatures between 6c and 60c. Water temperatures in the range of 20c to 45c seem to favour growth. The organisms do not appear to multiply below 20c and will not survive above 60c. They may, however remain dormant in cool water and multiply only when water temperatures reach a suitable level. Temperatures may also influence virulence. Legionella bacteria held at 37c have a greater virulence than the same legionella bacteria kept at a temperature below 25c.

Legionella bacteria also require nutrients to multiply. Sources can include commonly encountered organisms within the water system itself such as algae, amoebae and other bacteria. The presence of sediment, sludge, scale and other material within the system, together with biofilms, are also thought to play an important role in harbouring and providing favourable conditions in which the legionella bacteria may grow. A biofilm is a thin layer of micro-organisms which may form a slime on the surfaces in contact with water. Such biofilms, sludge and scale can protect legionella bacteria from temperatures and concentrations of biocide that would otherwise kill or inhibit these organisms if they were freely suspended in the water.

As legionella bacteria are commonly encountered in environmental sources they may eventually colonise manufactured water systems and can be found in cooling tower systems, hot and cold water systems and other plant which use or store water. To reduce the possibility of creating conditions in which the exposure to legionella bacteria is increased, it is important to control the risk by introducing measures which:

1. Do not allow proliferation of the organisms in the water system and
2. Reduce, so far as is reasonably practicable, exposure to water droplets and aerosol

LIST OF CONTENTS

Survey Objective

Risk Description

Section 1 Site Information

Section 2 Nominated Personnel

Section 3 Schematic Drawing

Section 4 Record Keeping

Section 5 Water Supply To Site

Section 6 Cold Water Storage

Section 7 Hot Water Storage

Section 8 Sentinel Taps (Nearest & Furthest)

Section 9 Miscellaneous Systems

Section 10 Outlets

Section 11 Point of Use Water Heaters

Section 12 Showers

Section 13 Recommendations Summary for Remedial Work

Section 14 Recommendation completed work

Section 15 Regular Procedures for The Control of Legionella (Written Scheme)

SURVEY OBJECTIVE

The purpose of this survey is to identify the risks of a hot and cold water storage and distribution service, developing legionella bacteria in accordance with, and under the HSC L8 and ACOP guidelines.

Distinction is made between potable water standards (BS8558) and wholesome water hygiene. Where necessary, remarks will be made as to suitable remedial works to bring a system to BS8558/BS EN 806 standard but this is not within the remit of this survey.

This Risk assessment has been revised to fulfill the requirements of:

HSG 274

The Control of Legionella Bacteria in Water Systems

The survey forms have been compiled to give a good level of information relating to the quality of building services; any potential risks; and recommendations for remedial actions. To assist in this, photographic evidence is added.

The report is based on visual identification and, unless detailed building plans are available, the schematic diagrams are restricted by observance techniques. Laboratory analysis will not be a routine and are outside the parameters of this survey, but if risks are suspected, further action for water sampling will first be agreed.

When to review the assessment

The record of the assessment is a living document that must be reviewed to ensure it remains up to date. Arrange to review the assessment regularly and specifically when there is reason suspect it is no longer valid. An indication of when to review the assessment and what to consider should be recorded. This may result from eg:

- A) Changes to the water system or its use.
- B) Changes to the use of the building in which the water system was installed.
- C) The availability of new information about risk or control measures.
- D) The results of checks indicating that the control measure are no longer effective.
- E) Changes to key personnel.

A case of legionnaires disease/legionellosis within the system.

To be carried out at least every 2 years

Risk Description

<u>ACTION REQUIRED</u>
<u>Very High Risk.</u> Consider shutting down system. Use qualified external expertise
<u>High Risk.</u> Determine measures to bring the system under control. Obtain specialist support as necessary.
<u>Medium Risk:</u> Review systems already in place and improve as necessary
<u>Low Risk.</u> Implement when any changes are made to the system

Water Temperature Risk

Below 20c Low Risk

21c To 25C Medium Risk

26c To 45c High Risk

46c To 55c Medium Risk

Above 55c Low Risk

1 Site Information

Summary of Water Services

Description of building


Sports Pavilion

Description	Yes / No
Mains Water Supply	Yes
Cold Water Storage	No
Calorifier / Hot Water Supply	No
Hot & Cold Water Distribution	Yes
Point of Use water heaters	Yes
Showers	Yes
Outlets	Yes
Miscellaneous Systems / Items	No

2 Nominated Personnel

Duty holder	To be completed by site
Nominated responsible person	
Maintenance	
Others	Aquacare

Isfield Pavilion - Isfield

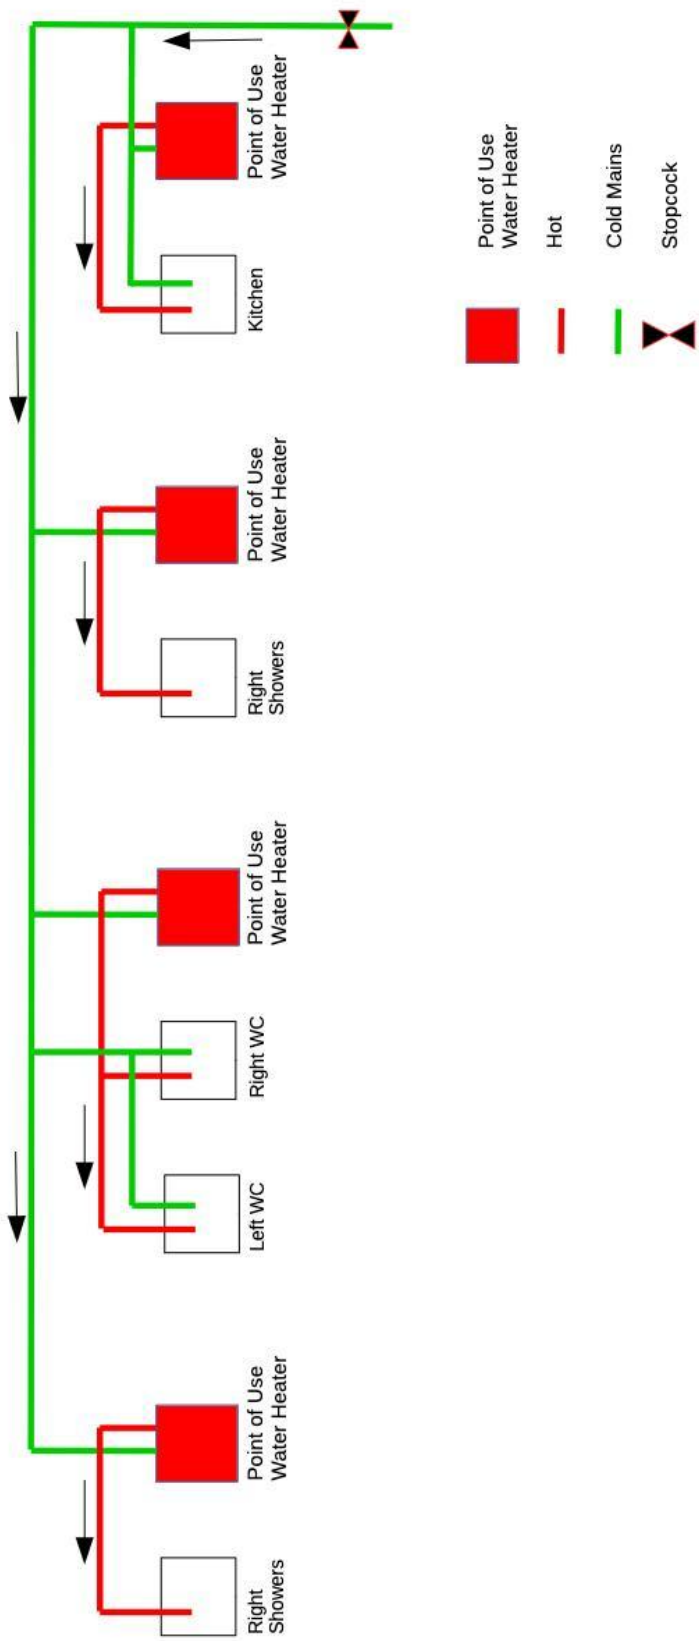

4 Record Keeping

Is there a site log book	No
Reference to a written scheme for monitoring	Within this document
An up to date schematic drawing of the system	Within this document
Records of temperature control regime	Yes
Records of system clean and disinfection	Yes

Comments: Satisfactory

5 Water Supply To Site

Source of supply	Mains
Location of stop cock	Believed to be in locked storeroom
Materials of construction of pipework	Copper
Do outlets conform to current regulations	Yes
Do materials and fittings conform to WRAS	Yes
What is the nearest incoming mains water temperature.	16c
What is the furthest incoming mains water temperature.	16c
Is there any dead leg pipework	No
Is it possible to cross contamination to occur	No
Does the main supply a water softener	No
Is the water softener serviced or disinfected	N/a
Is the pipework insulated	No
Is the direction of flow indicated	No
Is BS identification visible	No
Are unvented water system fitted	No
Are any pumps fitted	No
If more than one pump are they alternated or both running	No
Is there any other unused equipment fitted	No

Comments. Satisfactory

6 Cold Water Storage

There are no cold water storage tanks on site.

7 Hot Water Storage (Calorifiers/Cylinders)

All hot water is provided by four point of use water heaters.

8 Sentinel Taps

Nearest and furthest outlets

System	Nearest	Furthest
Mains	Kitchen 16c	Left WC Sinks 16c
Cold water down service	N/a	N/a
Hot water	N/a – Individual POU’s	N/a – Individual POU’s

9 Miscellaneous Systems

None on Site

10 Outlets

Location	No. of sinks baths etc	Temperature Hot after 1 minute Celsius	Temperature Cold after 2 minutes Celsius	Comments
Kitchen	1	POU – 72c	16c	Satisfactory
Right WC's	2	POU – 62c	16c	Satisfactory
Left WC's	2		16c	Satisfactory

Any scale on outlets	No
Any outlets used less than weekly	No
Are blending valves close enough to the outlets	N/a
Are temperatures satisfactory	Yes
Are temperatures taken & recorded monthly	Yes
Is there any dead leg pipework	No
Pipework insulated	No
Comments	Satisfactory.

11 Point of use water heaters

Location	Is the water heater storage or non storage	Temperature of stored water (Celsius)	Comments
Kitchen	15 litre Storage	72c	Satisfactory
Right/Left WC's	15 Litre Storage	62c	Satisfactory
Right Showers	10 Litre Storage	56c	Satisfactory
Left Showers	10 Litre Storage	16c (Not Working)	Satisfactory
Gents WC	Non	20c	Satisfactory

Kitchen POU



Right/Left WC's



Right Showers



Left Showers (Not Working)



12 Showers

Location	No. of showers	Does hot water reach blender valve within 1 minute	Does cold water reach blender valve within 2 minutes	Comments
Right Showers	2	Yes	N/a	Satisfactory
Left Showers	2	Yes	N/a	Satisfactory

Any scale on outlets	No
Any outlets used less than weekly	Sometimes
Are blending valves close enough to the outlets	No

Comments.

The showers are fed by point of use water heaters; there are no thermostatic mixing valves adding cold to the water.

Satisfactory

12 Showers

Right Showers



Left Showers



13 Recommendations Summary for remedial work

There are no recommendations for remedial works at this time.

14 Recommendations work completed

There are no recommendations for remedial works at this time.

15 Regular procedures for the control of Legionella

(Written Scheme for Isfield Sports Pavilion)

Temperature monitoring

Stored water point of use water heaters should be checked and temperatures recorded 6 monthly to ensure that they are at least 55c

Showers

Showers should be used or flushed weekly. Showers heads and hoses should be descaled and disinfected quarterly.

Outlets

Any unused outlets should be flushed weekly

Training



This is to certify that

Mr Mark Fry

of

Aquacare Ltd

has completed a one day training course on
**Practical Legionella Risk Assessment Hot & Cold
Water Systems Advanced**

Subjects covered include:

Legionella medical aspects and the legal requirements for Risk Assessors
The written scheme
Risk Assessment theory - simple & extended
Reviewing records, credibility and competence assessments
Practical guidance on preparing for and carrying out Legionella Risk Assessment
The questions to ask and how to ask them when risk assessing
Reporting, writing & presenting risk assessment reports


WMSoc ACCREDITED

The candidate showed capability of working in a safe & efficient manner during the practical work & presentations

The following level was attained at the end-of-day assessment

Distinction

Signed



CPD Units 6 Hours

Date: 08/11/2022

Certificate Number: 8136

C&G Enrolment Number: HGU0330

The Water Management Society recommends that training is refreshed at least every 3 years

The Water Management Society Limited, 6 Fairway Court,
Amber Close, Tamworth, Staffordshire, B77 4 RP.
Telephone: 01827 289558 www.wmsoc.org.uk

TRAINING COURSE



THIS IS TO CERTIFY THAT

Mark Fry

Passed the W201 Legionella Control and The Law Online Course
on 06/11/2022

and has been awarded 1 CPD point



Signed

Date

[Signature]

06/11/2022

Certificate Number LMS674

TRAINING COURSE



THIS IS TO CERTIFY THAT

Mark Fry

Passed the W202 Legionellosis Causes and Impacts of Infection
Online Course on 06/11/2022

and has been awarded 1 CPD point



Signed

Date

[Signature]

06/11/2022

Certificate Number LMS675



Stefan Halsey
3 St Leonards Road,
Denton,
Newhaven,
BN9 0RN

Isfield Parish Council

3/7/2026

Dear Anita Emery and others,

I have included two options for the balustrade to give you a choice. I feel an alternative design could provide a cleaner, more attractive appearance while also being better suited to its intended purpose. The existing style had a tendency to encourage climbing, so the alternative option may offer a more practical solution. Both options have come out at the same price.

Please see below for 2 options regarding the new Isfield Pavillion Balustrade.

Option 1 - Balustrade Design to match the existing design as requested:

- Made out of a mix of Scandinavian redwood and pre-treated timber.
- Sizes then matched to existing.
- Cut ends treated where required.
- Suitable fixings used where needed.
- Old materials removed and taken from site.

Note: As discussed. No decorating (Staining) allowed for.

Total Materials and Labour: £2,700.00

Option 2 – Balustrade design changed to Hand rail, Spindles and Base rail.

- Made out of Scandinavian redwood.
- Handrail in same place as existing, running around perimeter.
- Base rail below, set off the floor roughly 100mm to keep out of any water.
- Spindles set around the balustrade at no more than 99mm spacings.
- Old materials removed and taken from site.

Notes: Same again, no decorating allowed for.

Total Materials and Labour: £2,700.00

Kind regards,

Stef Halsey

Isfield Parish Council
June 2026 Expenditure

Date	Reference	Supplier / Customer	Description	Payment
30.6.2026		A Emery	Salary	506.78
30.6.2026		HMRC Mth 3	PAYE/NIC	153.04
30.6.2026		ES Pension Fund	June remittance	150.09
30.6.2026		Aquacare	Legionella risk assessment Pavilion	264.00
30.6.2026		Clean Corner	Pav cleaning	144.00
30.6.2026		A Scantlebury	Grant	100.00
30.6.2026		S Crammond	Fete Raffle prize expenses	59.50
30.6.2026		Castle Water	PF Water Direct Debit	20.34
30.6.2026		Barcombe Landscapes	Grass Cutting	764.40
30.6.2026		Isfield Village Hall	Hire	32.00
30.6.2026				
30.6.2026				
30.6.2026				
Total April 2026 Expenditure				2,194.15

Isfield Parish Council

Bank account: Current
Account

Date range: 01/07/2026 to 31/03/2027

Voucher	Date	Reference	Supplier / Customer	Description	Receipt	Payment	Balance	Date reconciled
	01/07/2026		Opening balance b/fwd				91086.83	
276	15/07/2026	262725dd	Castle Water	Water supply		16.20	91,070.63	
271	15/07/2026	262726	A Emery	Clerk Salary Mth 4		506.78	90,563.85	
272	15/07/2026	262727	HMRC	HMRC Mth4		153.04	90,410.81	
273	15/07/2026	262728	ES Pension Scheme	Pension remittance Mth4		150.09	90,260.72	
274	15/07/2026	262729	A Emery	July expenses		23.40	90,237.32	
275	15/07/2026	262730	Clean Corner	Pav cleaning		144.00	90,093.32	

Isfield Parish Council

Budget report from 1-Apr-2026 to 31-Mar-2027 (figures exclude VAT)

All reserves 15th July 2026

Payments

	Year to date		
	Budget	Actual	Variance
Other Payments			
Miscellaneous Payments	0.00	0.00	0
Total Other Payments	0.00	0.00	0.00
General Maintenance			
General Maintenance	500.00	36.99	463.01
Total General Maintenance	500.00	36.99	463.01
Website			
Website	510.00	255.00	255
Total Website	510.00	255.00	255.00
Communication/Newsletter			
Communication/Newsletter	515.00	0.00	515
Total Communication/Newsletter	515.00	0.00	515.00
Pavilion Expenses			
Pavilion Cleaning	1,650.00	480.00	1170
Pavilion Expenditure	1,000.00	386.16	613.84
Defib expenses	75.00	0.00	75
Total Pavilion Expenses	2,725.00	866.16	1,858.84
Defib expenses			
Total Defib expenses	0.00	0.00	0.00
Elections			
Elections	0.00	0.00	0
Total Elections	0.00	0.00	0.00
Sundries			
Sundries	50.00	59.50	-9.5
Total Sundries	50.00	59.50	-9.50
Community Infrastructure Levy ex			
CIL Expenditure	0.00	0.00	0
Total Community Infrastructure Levy ex	0.00	0.00	0.00
S106 Expenditure			
S106 Expenditure	0.00	0.00	0
Total S106 Expenditure	0.00	0.00	0.00
Grants and Subscriptions			
Grants and Subscriptions	2,620.00	848.56	1771.44
Community Grants	0.00	0.00	0
Total Grants and Subscriptions	2,620.00	848.56	1,771.44
Community Grants			
Total Community Grants	0.00	0.00	0.00
Litter picking			
Litter Picking	1,200.00	0.00	1200
Total Litter picking	1,200.00	0.00	1,200.00
Pavilion cleaning			
Total Pavilion cleaning	0.00	0.00	0.00
Salaries			
Salaries	12,500.00	3,239.64	9260.36
Clerk Expenses	130.00	30.42	99.58
Total Salaries	12,630.00	3,270.06	9,359.94
Pension			
Total Pension	0.00	0.00	0.00
Employers PAYE/NIC			
Total Employers PAYE/NIC	0.00	0.00	0.00
Clerk expenses			
Total Clerk expenses	0.00	0.00	0.00
Stationery			
Total Stationery	0.00	0.00	0.00
Hall Hire			
Hall Hire	240.00	60.00	180
Total Hall Hire	240.00	60.00	180.00
Conf/Course/Travel expenses			
Conf/Course/Travel	200.00	0.00	200
Total Conf/Course/Travel expenses	200.00	0.00	200.00
Insurance			
Insurance	3,000.00	0.00	3000
Total Insurance	3,000.00	0.00	3,000.00
Audit/Professional Fees			
Audit/Professional Fees	1,000.00	150.00	850
Total Audit/Professional Fees	1,000.00	150.00	850.00
Grass cutting			
Total Grass cutting	0.00	0.00	0.00
Hedge cutting			
Total Hedge cutting	0.00	0.00	0.00
Playing Field			
Grass Cutting	3,600.00	1,954.10	1645.9
Hedge Cutting	0.00	0.00	0
Tree Work	1,000.00	0.00	1000
Total Playing Field	4,600.00	1,954.10	2,645.90
Total Payments	29,790.00	7,500.37	22,289.63

Receipts

	Year to date		
	Budget	Actual	Variance
Other Receipts			
VAT Repayments	0.00	596.75	596.75
Miscellaneous Receipts	0.00	0.00	0
Total Other Receipts	0.00	596.75	596.75
Precept			
Precept	29,780.00	14,890.00	-14890
Total Precept	29,780.00	14,890.00	-14,890.00
VAT reclaim			
Total VAT reclaim	0.00	0.00	0.00
Donations			
Donations	0.00	0.00	0
Total Donations	0.00	0.00	0.00
Bank interest			
Bank Interest	10.00	12.24	2.24
Total Bank interest	10.00	12.24	2.24
Other			
Other	0.00	0.00	0
Total Other	0.00	0.00	0.00
Community Infrastructure Levy			
Community Infrastructure Levy	0.00	0.00	0
Total Community Infrastructure Levy	0.00	0.00	0.00
S106			
S106 Receipts	0.00	0.00	0
Total S106	0.00	0.00	0.00
Total Receipts	29,790.00	15,498.99	-14,291.01

Isfield Parish Council

Details of bank reconciliation dated 2026-07-15 for Current Account

Report produced on 15/07/2026

Opening statement balance

94845.84

Reconciled transactions

Voucher	Date	Type	Reference	Supplier / customer	Description	Amount
249	29/04/2026	Payment	262709	ICO	ICO Annual subs	-47.00
258	14/05/2026	Payment	262719	Wealden Citizens Advice	Wealden Citizens Advice Grant	-200.00
257	14/05/2026	Payment	262718	Isfield Village Hall	Hall Hire March 2026	-28.00
256	14/05/2026	Payment	262717	Castle Water	Water charges	-4.47
255	14/05/2026	Payment	262716	Clean Corner	March and April	-288.00
254	14/05/2026	Payment	262715	Narke Design	Domain Hosting	-30.00
253	14/05/2026	Payment	262713	ES Pension Scheme	Pension Mth 2	-150.09
252	14/05/2026	Payment	262712	HMRC	HMRC Mth2	-153.04
251	14/05/2026	Payment	262711	A Emery	Mth 2	-506.78
270	30/06/2026	Payment	262725	Isfield Village Hall	Hall Hire	-32.00
269	30/06/2026	Payment	262725	Barcombe Landscapes	Playing Field grass cutting	-764.40
268	30/06/2026	Payment	262724	Castle Water	Water supply	-20.34
267	30/06/2026	Payment	262723	Cllr S Crammond	Raffle prize	-59.50
266	30/06/2026	Payment	262722	Adele Scantlebury	Grant application	-100.00
265	30/06/2026	Payment	262721	Clean Corner	Pav cleaning	-144.00
264	30/06/2026	Payment	262720	Aquacare	Legionella testing	-264.00
263	30/06/2026	Payment	262719	ES Pension Scheme	Pension contributions Mth 3	-150.09
262	30/06/2026	Payment	262718	HMRC	HMRC Mth 3	-153.04
261	30/06/2026	Payment	262717	A Emery	Clerk Salary	-506.78
277	30/06/2026	Payment	262731	James Fellows	New water heater	-157.48

Reconciled balance

91,086.83

Uneconciled transactions

Voucher	Date	Type	Reference	Supplier / customer	Description	Amount
271	15/07/2026	Payment	262726	A Emery	Clerk Salary Mth 4	-506.78
273	15/07/2026	Payment	262728	ES Pension Scheme	Pension remittance Mth4	-150.09
274	15/07/2026	Payment	262729	A Emery	July expenses	-23.40
275	15/07/2026	Payment	262730	Clean Corner	Pav cleaning	-144.00
276	15/07/2026	Payment	262725	dd Castle Water	Water supply	-16.20
272	15/07/2026	Payment	262727	HMRC	HMRC Mth4	-153.04

Cash book balance

90,093.32

Isfield Parish Council

Details of bank reconciliation dated 2026-07-15 for Premium Acc 7720

Report produced on 15/07/2026

Opening statement balance **1155.92**

Reconciled transactions

Voucher	Date	Type	Reference	Supplier / customer	Description	Amount
278	15/07/2026	Receipt	Int	Barclays Bank	Bank Interest	3.29

Reconciled balance **1,159.21**

Cash book balance **1,159.21**

Isfield Parish Council

Details of bank reconciliation dated 2026-07-15 for Premium Acc 6278

Report produced on 15/07/2026

Opening statement balance **3141.34**

Reconciled transactions

Voucher	Date	Type	Reference	Supplier / customer	Description	Amount
279	15/07/2026	Receipt	Int	Barclays Bank	Bank Interest	8.95

Reconciled balance **3,150.29**

Cash book balance **3,150.29**

Isfield Parish Council

List of Correspondence received

From 15th May 2026

	Issued to
1. M Anton – WWII defences	Clerk/IPC
2. L Kavanagh – Pavilion	Clerk/IPC
3. A Hall – electric scooter anti social	Clerk/IPC
4. Wealden Citizens Advice – thank you	Clerk/IPC
5. H Burton – WDC Planning query	Clerk/AK
6. AFC Uckfield – various	Clerk/AK
7. EDF – pavilion electric – various	Clerk
8. ICO – annual subscription	Clerk
9. WDC – CIL reporting	Clerk
10. CBS Fire Risk Assessment quote pavilion	Clerk
11. B Still – Aug pitch hire	Clerk
12. K Potter – Artwaves grant	Clerk/IPC
13. S Halsey – balustrade quote	Clerk/AK
14. Aquacare – Legionnaires report	Clerk
15. J Moon – use of PF car park various	Clerk/AK
16. AFC Uckfield Pitch Hire	Clerk
17. WDALC – agenda	Clerk/IPC
18. L Alexander – community pitch/eco forum	Clerk/GS/AK
19. Aditil – PAT testing pavilion	Clerk/AK
20. M Trotter – Fire Risk Assessment	Clerk/AK
21. V Hughes – Stoolball fixtures	Clerk/AK
22. D Jenner – football training	Clerk/AK
23. H Goring – Wealden Clerks meet	Clerk
24. Stef Halsey – Balustrade – Pav	Clerk/IPC
25. A Stevens – WDALC AGM Mins	Clerk/IPC
26. R Levett – Isfield VH charity information	Clerk
27. Garrison roofing – repairs	Clerk/AK
28. ESALC – various	Clerk
29. Clerks & Council Direct mag	Clerk

- 30. Major Projects and Growth Team ESH
- 31. Little Horsted PM – Steve Tilbury payment
- 32. L Alexander – Eco Forum (Barcombe PC)
- 33.
- 34.

Clerk/IPC
Clerk
Clerk/IPC